


PLAN VIEW

- NOTES**
1. ALLOW 2 METRES MIN OF SLACK A.R.B. CABLE TO BE LOOSE INSIDE CHAMBER IMMEDIATELY UNDER LID. FOLD ADDITIONAL CABLE, DO NOT COIL. MINIMUM 4 WIRE 24 AWG CABLE TO BE USED. 3 WIRES REQUIRED TO BE CONNECTED TO THE METER IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS.
 2. REDUCED PRESSURE BACKFLOW DEVICES ARE NOT TO BE INSTALLED BELOW GRADE.

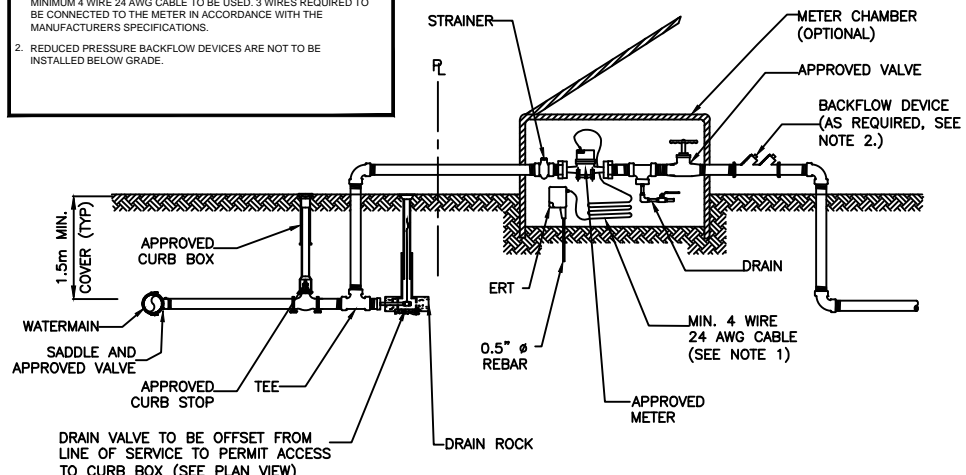

SECTION VIEW

<p>REGIONAL DISTRICT OF NORTH OKANAGAN</p> <p>9848 Aberdeen Road, Coldstream, BC V1B 2K9 PH: 250-550-3700 FAX: 250-550-3701</p>		<p>TITLE TYPICAL IRRIGATION SERVICE</p>	
		<p>38mm - 75mm</p>	
DATE	SCALE	DRAWING No.	REV.
OCT. 2015	N.T.S.	RDNO-08	5