


NOTES

1. ELEVATION OF WATER METER MUST BE ABOVE HIGHEST ELEVATION OF WATER TABLE
2. WATER METER MUST BE LOCATED UPSTREAM OF ALL DOMESTIC BRANCH LINES, TEES OR JUNCTIONS. ALL WATER USED FOR DOMESTIC PURPOSES (WHICH INCLUDES LAWN AND GARDEN) MUST BE DIRECTED THROUGH THE METER
3. WATER METER MUST NOT BE LOCATED UNDER AN AREA TRAVELED BY MOTOR VEHICLES
4. WHERE MAXIMUM STATIC WATER PRESSURE IS GREATER THAN 827 KPa (120 PSI), A PRESSURE REDUCING VALVE MUST BE INSTALLED UPSTREAM OF THE METER AND COPPER LINE AND FITTINGS MUST BE USED UPSTREAM OF THE PRV
6. ALLOW 2 METRES MIN OF SLACK A.R.B. CABLE TO BE LOOSE INSIDE CHAMBER IMMEDIATELY UNDER LID.
MINIMUM 4 WIRE 24 AWG CABLE TO BE USED. 3 WIRES REQUIRED TO BE CONNECTED TO THE METER IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS.
7. ERT SECURELY MOUNTED IN METER BOX. USE OF THROUGH LID MOUNTING KIT IS OPTIONAL. MUST BE "PIT ERT" IF LOCATED IN CONCRETE BOX.
8. PLASTIC PVC METER BOX TO HAVE TO HAVE MINIMUM 75mm (3 INCHES) CLEARANCE TO FITTINGS AT EACH END.

METER BOX TO BE PRE-FABRICATED HIGH DENSITY POLYETHYLENE, FIBER REINFORCED PLASTIC, OR REINFORCED CONCRETE. OTHER MATERIALS TO BE APPROVED BY GVS PRIOR TO INSTALLATION.

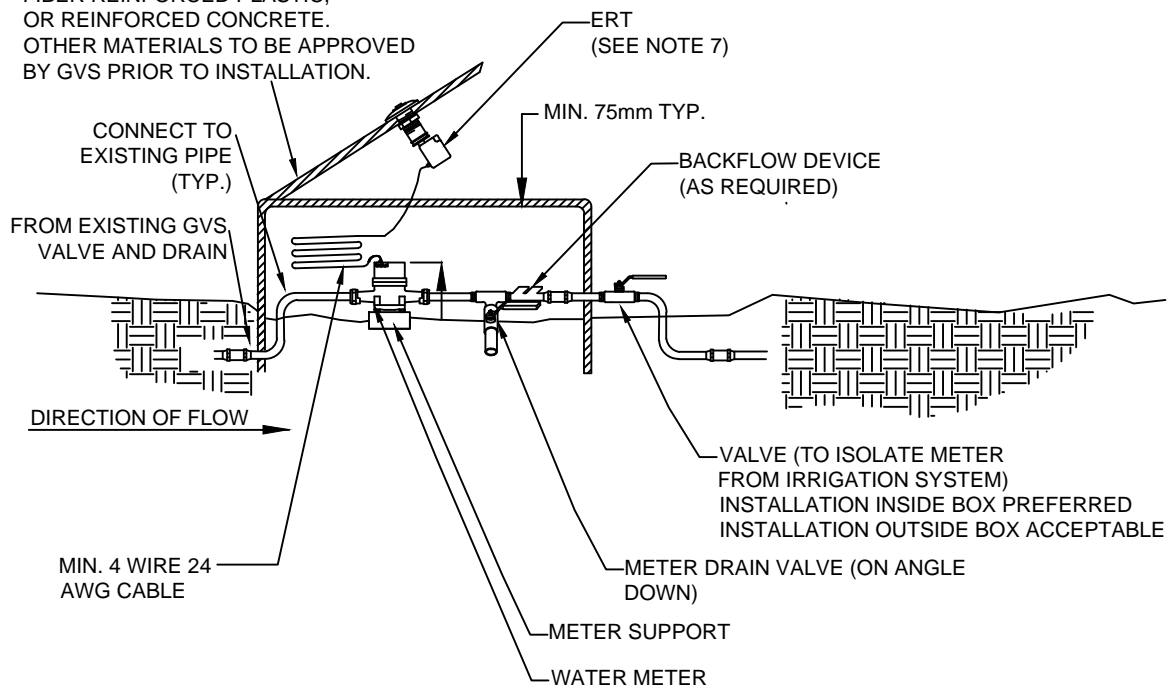

**REGIONAL DISTRICT
OF NORTH OKANAGAN**

9848 Aberdeen Road, Coldstream, BC V1B 2K9
PH: 250-550-3700 FAX: 250-550-3701



TITLE

**TYPICAL OUTDOOR
WATER METER BOX**

DATE

OCT. 2015

SCALE

N.T.S.

DRAWING No.

W-17

REV.

3