

Note:
 Pipe supports to be 450mm (L) x 200mm (W) x 600mm (H)
 cast-in-place reinforced concrete c/w steel bolt down anchors


This map was compiled by RDNO, using data believed to be accurate; however, a margin of error is inherent in all maps. This product is distributed without warranties of any kind, either express or implied, including but not limited to warranties of sustainability or particular purpose or use.

GVRDF Leachate Pump Station - Plan Sheet D-1



Plot Date: Aug 16, 2016

Scale: NTS
 Plot Size: 11" x 8.5"

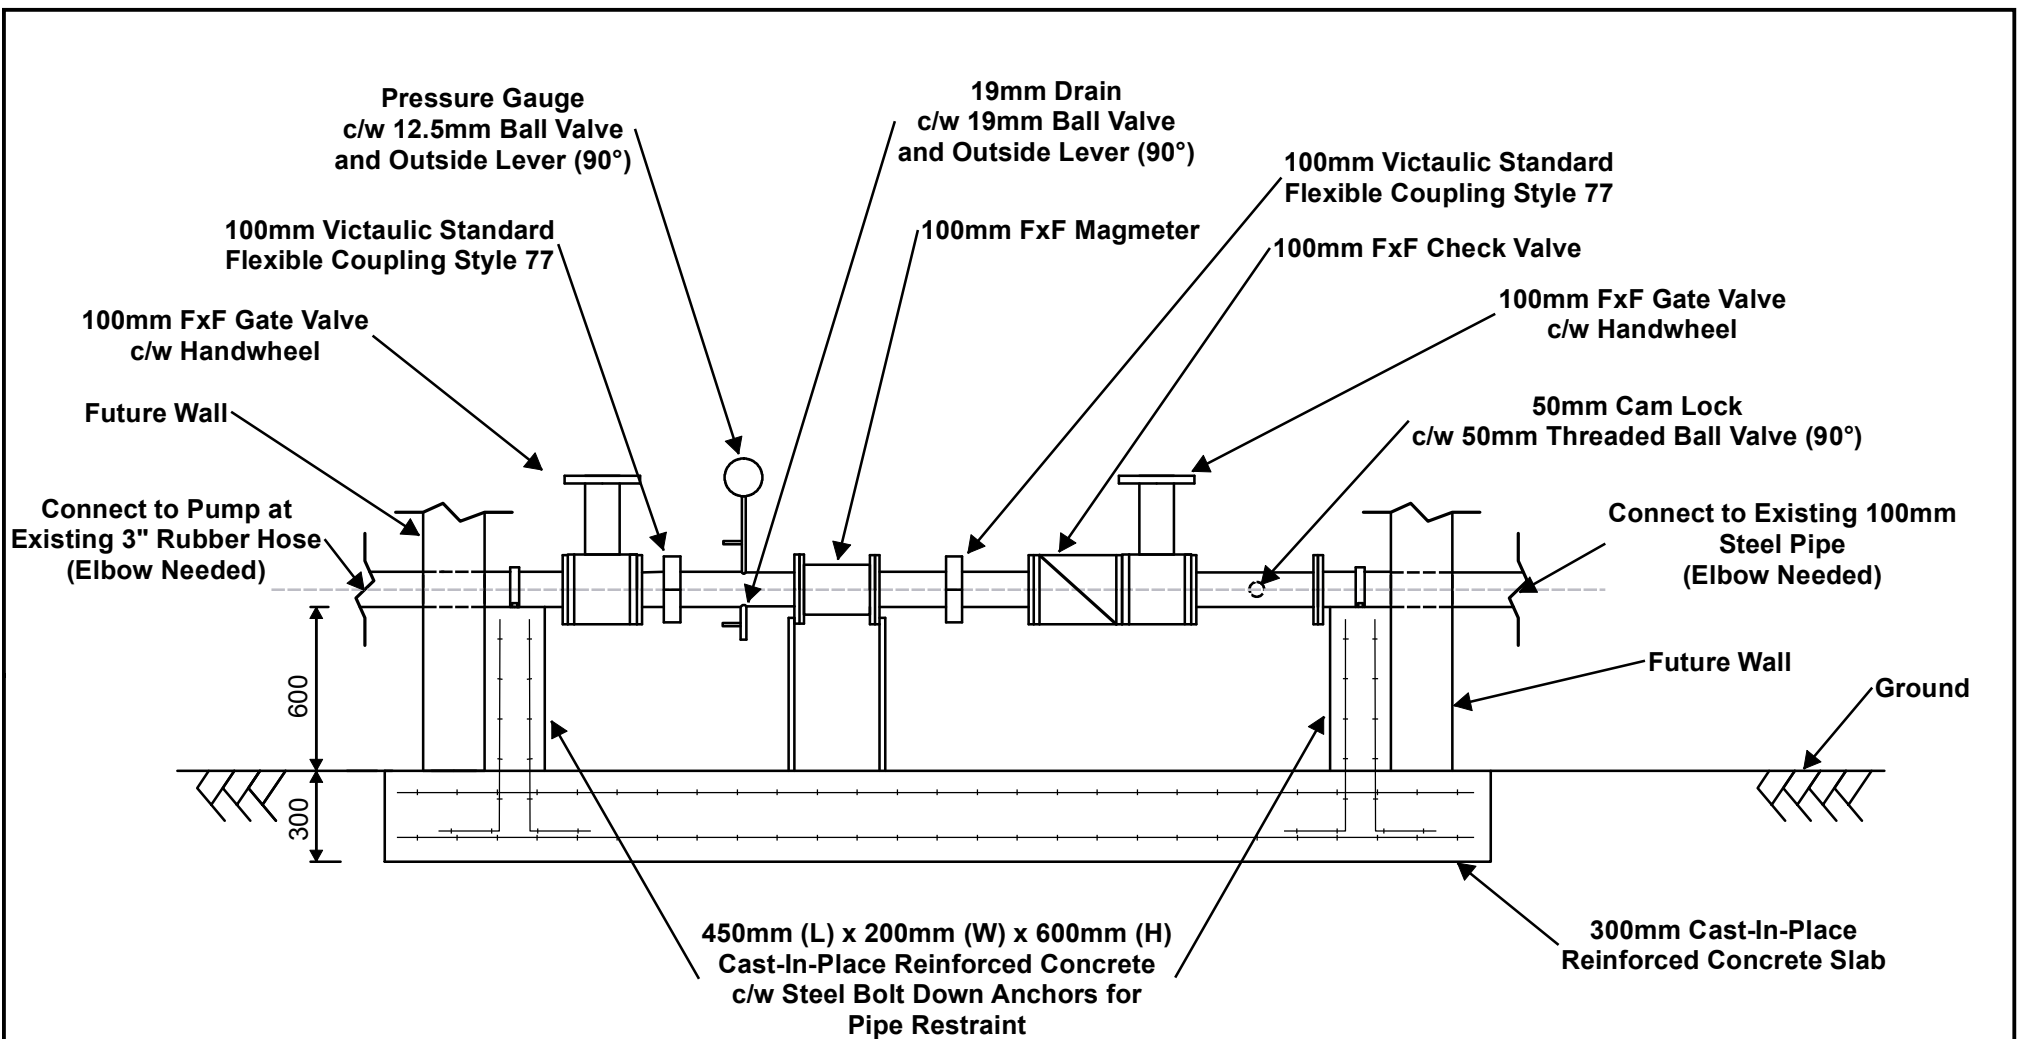

Note:
 -All fabricated piping to be 316 stainless steel
 -Concrete to be 28 MPA and constructed to
 Section 03 30 53 of MMCD Specifications
 -Concrete slab reinforcing to be 15M @ 300 c/c
 both directions and two layers
 -Concrete pipe restraint reinforcing to be 15M @ spacing as follows:
 W direction to be 50mm, 100mm, and 50mm spacing (2 bars)
 L direction to be 75mm, 150mm, 150mm, and 75mm spacing (3 bars)

This map was compiled by RDNO, using data believed to be accurate; however, a margin of error is inherent in all maps. This product is distributed without warranties of any kind, either express or implied, including but not limited to warranties of sustainability or particular purpose or use.

GVRDF Leachate Pump Station - Profile Sheet D-2



Plot Date: Aug 16, 2016

Scale: 1:25

Plot Size: 11" x 8.5"

