



NOTES

1. ELEVATION OF WATER METER MUST BE ABOVE HIGHEST ELEVATION OF WATER TABLE
2. WATER METER MUST BE LOCATED UPSTREAM OF ALL DOMESTIC BRANCH LINES, TEES OR JUNCTIONS. ALL WATER USED FOR DOMESTIC PURPOSES (WHICH INCLUDES LAWN AND GARDEN) MUST BE DIRECTED THROUGH THE METER
3. WATER METER MUST NOT BE LOCATED UNDER AN AREA TRAVELED BY MOTOR VEHICLES
4. WHERE MAXIMUM STATIC WATER PRESSURE IS GREATER THAN 827 KPa (120 PSI), A PRESSURE REDUCING VALVE MUST BE INSTALLED UPSTREAM OF THE METER AND COPPER LINE AND FITTINGS MUST BE USED UPSTREAM OF THE PRV
5. INSULATING DISK MATERIAL TO BE MINIMUM OF R-14. DISK SHALL BE TIGHT SEALED AROUND EDGE WITH NO FREE AIR PASSAGE
6. ALLOW 2 METRES MIN OF SLACK A.R.B. CABLE TO BE LOOSE INSIDE CHAMBER IMMEDIATELY UNDER LID. FOLD ADDITIONAL CABLE, DO NOT COIL.
MINIMUM 4 WIRE AWG CABLE TO BE USED. 3 WIRES REQUIRED TO BE CONNECTED TO THE METER IN ACCORDANCE WITH THE MANUFACTURERS SPECIFICATIONS
7. ERT SECURELY MOUNTED IN PIT ABOVE INSULATING FOAM DISK. USE OF THROUGH LID MOUNTING KIT IS OPTIONAL.
8. REDUCED PRESSURE BACKFLOW DEVICES ARE NOT TO BE INSTALLED BELOW GRADE.
9. APPROVED MATERIALS ONLY (EG. CAST IRON, POLYETHYLENE, ETC). PLYWOOD IS NOT ACCEPTED.

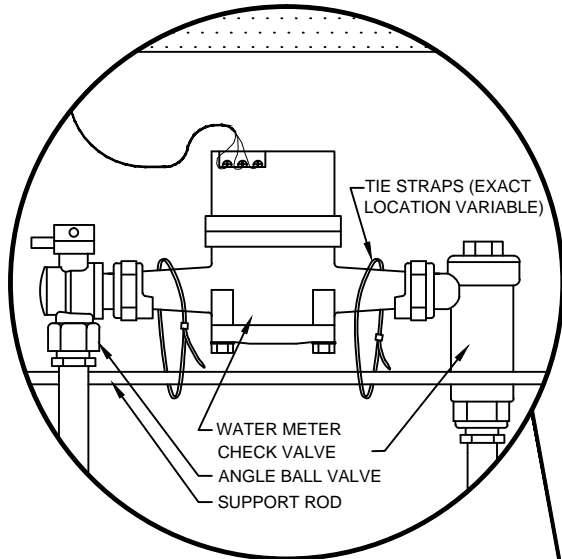

DETAIL

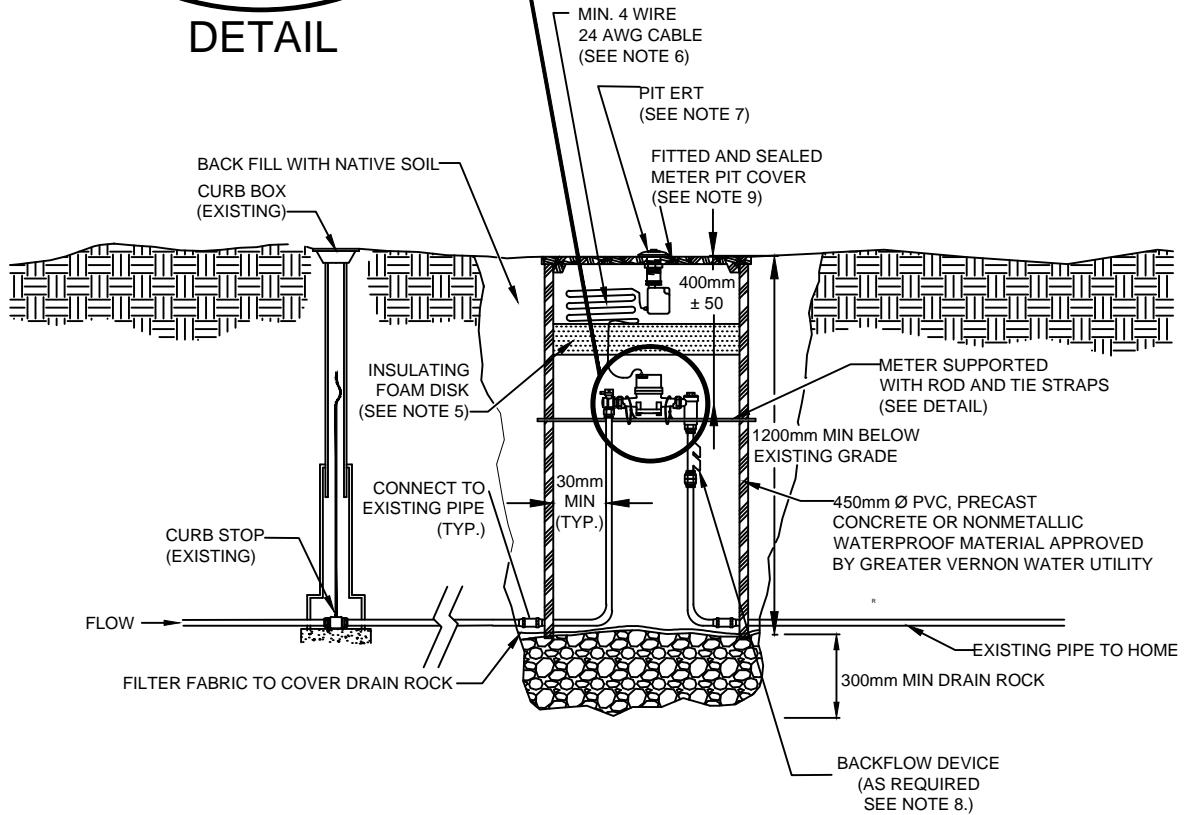

**REGIONAL DISTRICT
OF NORTH OKANAGAN**

9848 Aberdeen Road, Coldstream, BC V1B 2K9
PH: 250-550-3700 FAX: 250-550-3701



TITLE

**TYPICAL OUTDOOR
WATER METER PIT**

DATE

OCT. 2015

SCALE

N.T.S.

DRAWING No.

W-16

REV.

3