


NOTES

1. ELEVATION OF WATER METER MUST BE ABOVE HIGHEST ELEVATION OF WATER TABLE
2. WATER METER MUST BE LOCATED UPSTREAM OF ALL DOMESTIC BRANCH LINES, TEES OR JUNCTIONS. ALL WATER USED FOR DOMESTIC PURPOSES (WHICH INCLUDES LAWN AND GARDEN) MUST BE DIRECTED THROUGH THE METER
3. WATER METER MUST NOT BE LOCATED UNDER AN AREA TRAVELED BY MOTOR VEHICLES
4. WHERE MAXIMUM STATIC WATER PRESSURE IS GREATER THAN 827 KPa (120 PSI), A PRESSURE REDUCING VALVE MUST BE INSTALLED UPSTREAM OF THE METER AND COPPER LINE AND FITTINGS MUST BE USED UPSTREAM OF THE PRV
6. ALLOW 2 METRES MIN OF SLACK A.R.B. CABLE (MIN. 4 CONDUCTOR 24 AWG) TO BE LOOSE INSIDE CHAMBER IMMEDIATELY UNDER LID. TWO WIRES CONNECTED TO TOUCH PAD TO CORRESPOND WITH WIRES CONNECTED TO B AND R ON WATER METER (BLACK AND RED).
7. TOUCH PAD MAY BE MOUNTED TO SECURE POST OR METER BOX COVER. A DIFFERENT TOUCH PAD FOR MOUNTING ONTO COVER IS AVAILABLE AT R.D.N.O. AT NO CHARGE.
8. PLASTIC PVC METER BOX TO HAVE TO HAVE MINIMUM 75mm (3 INCHES) CLEARANCE TO FITTINGS AT EACH END.

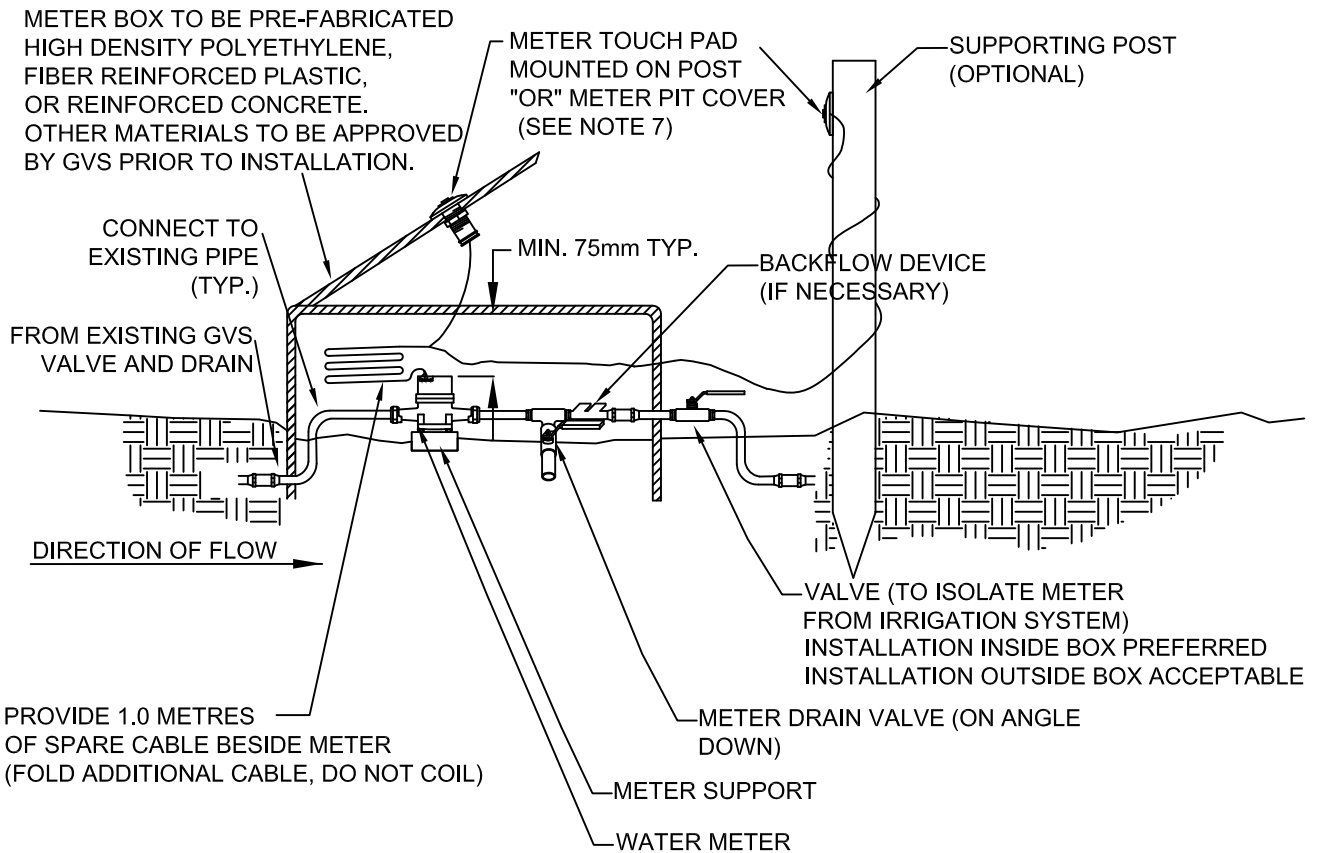

**REGIONAL DISTRICT
OF NORTH OKANAGAN**

9848 Aberdeen Road, Coldstream, BC V1B 2K9
PH: 250-550-3700 FAX: 250-550-3701



TITLE
**TYPICAL OUTDOOR
IRRIGATION WATER METER BOX**

DATE
MAY 2014

SCALE
N.T.S.

DRAWING No.
RDNO-07

REV.
4