
DATE: October 16, 2026
CONTACT: Tricia Brett, Manager, Water Quality
PHONE / EMAIL: 250.550.3700 / tricia.brett@rdno.ca

GREATER VERNON WATER – WATER QUALITY ADVISORY

**LAKERIDGE DR, LAKERIDGE CRT, LAKERIDGE PL, AMBER DR,
JASPER DR, 6671 – 6848 CAMEO DR, GARNET RD, TOPAZ RD, JADE
RD, OGATA WAY, 7301-7393 BELLA VISTA RD, FLEMMING RD,
JOHARON RD**

In conjunction with Interior Health, the Regional District of North Okanagan (RDNO) advises that some customers supplied by Greater Vernon Water are under a precautionary Water Quality Advisory (WQA) as of **10:00 am on Tuesday, October 20**. The affected area includes Lakeridge Dr, Lakeridge Crt, Lakeridge Pl, Amber Dr, Jasper Dr, 6671 – 6848 Cameo Dr, Garnet Rd, Topaz Rd, Jade Rd, Ogata Way, 7301-7393 Bella Vista Rd, Flemming Rd, Joharon Rd (see map).

A brief shutdown is scheduled between 10:00 am and 11:00 am to repair a leak in this area. While most homes in the area should have water throughout the shutdown, some may experience a loss of water. The RDNO is issuing a precautionary WQA for the affected area while sampling and testing of the water main are conducted to ensure the continued safety of the water system.

What should affected customers do?

Properties in the area may experience reduced water pressure, discolouration of the water, and/or air. Please run a cold water tap until the water has cleared. An outside tap is preferred, but bathtubs may be used if outside taps are unavailable during the cooler months.

The level of treatment provided by the RDNO has been maintained; however, customers in the affected area may wish to boil their water for at least one minute when preparing food, drinking, washing fruits and vegetables, making beverages or ice or when brushing teeth.

When this notice is rescinded, it will be posted on the RDNO website and sent out to email subscribers. If you wish to subscribe, please visit www.rdno.ca/subscribe.


If you have any questions, please contact the RDNO Utilities Department at 250-550-3700.

Do you know of another water main break or other water emergency?

Go to www.rdno.ca/emergencies for contact information, including information on what to do in the event of a water main break.

Legend

- Unaffected Properties
- Affected Properties

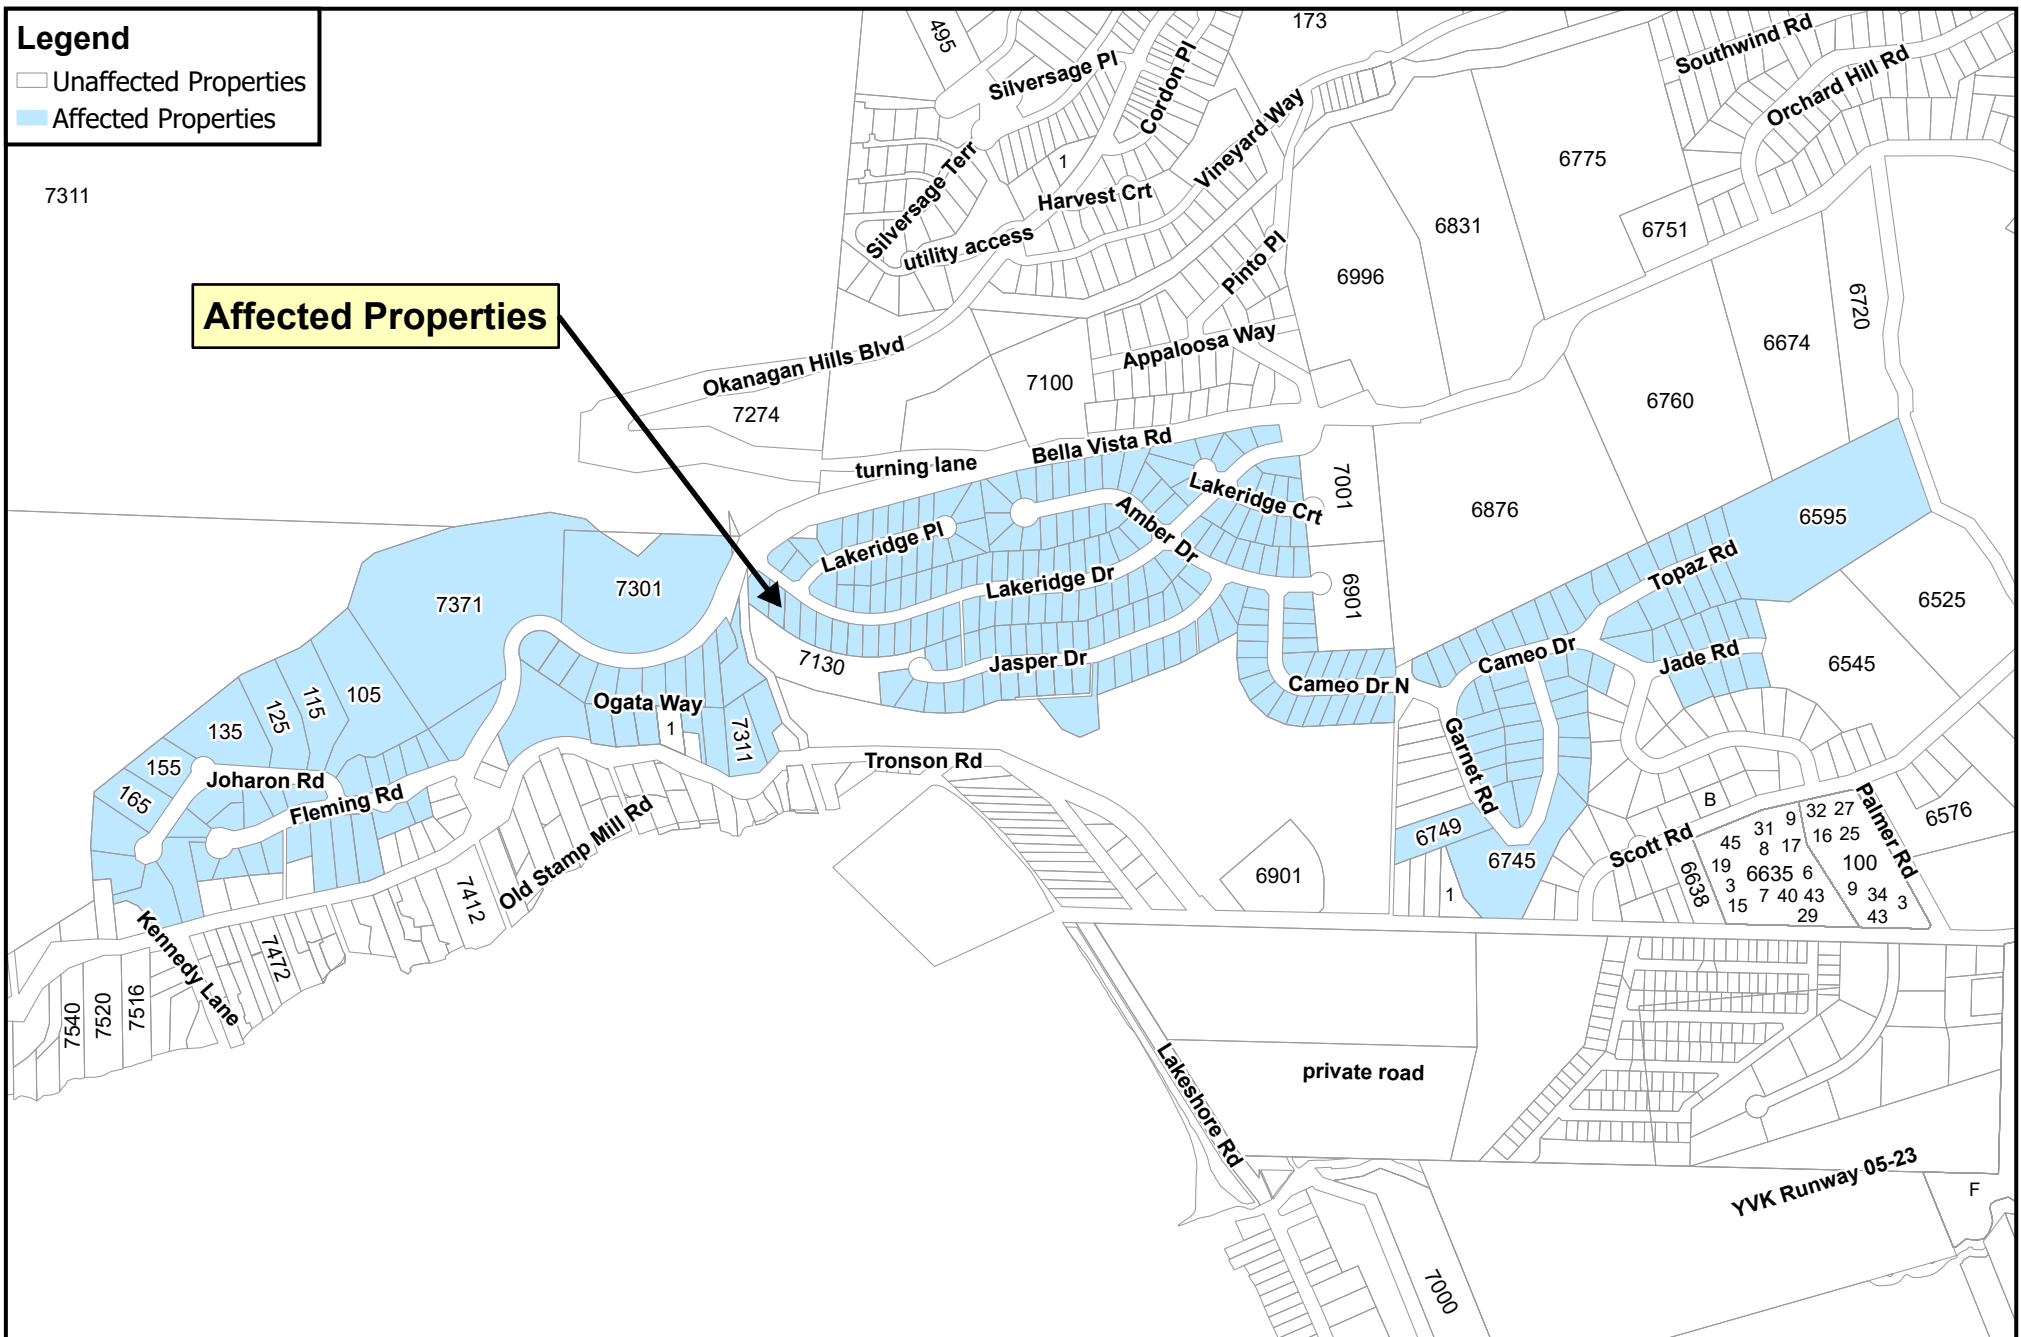

This map was compiled by RDNO, using data believed to be accurate; however, a margin of error is inherent in all maps. This product is distributed without warranties of any kind, either express or implied, including but not limited to warranties of sustainability or particular purpose or use.

Affected Properties



Date: Oct 16, 2026

Scale: 1:10,000

Size: 11" x 8.5"

